

StoneStyle - 450x600 PEARL LIMESTONE 120G HONED SAMPLE - Wet Sliptest Report - KO190719-5

19 Jul 2019

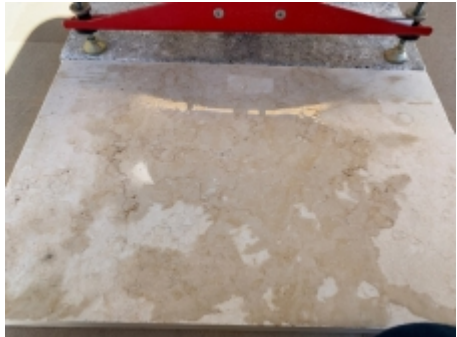
Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	19 Jul 2019
Test Report Number:	KO190719-5
Client Name & Address:	Stone Style - 50 Currumbin Creek Road Currumbin
Test Site / Surface Tested :	450x600 PEARL LIMESTONE 120G HONED SAMPLE
Sample Information :	Samples and Test Information Supplied by Client
Wet Pendulum Test carried out using :	Slider 96 (4S) Rubber slider
Record ambient temperature (°C)	22
Testing Officer :	Kathryn Ording
Testing Officer :	#SK2072 - Wessex Portable Skid Tester #SK2072 - 07.05.19

Testing Officer Signature



Test Results :

Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	Surface Picture
1A	35	35	34	34	34	34	
1B	35	34	33	33	33	33	
1C	35	35	34	34	34	34	
1D	35	34	35	35	34	35	
1E	35	36	33	33	33	33	

Mean BPN Slip Resistance Value (SRV)

34

CLASSIFICATION using Slider 96 (4S Slider)

P2 = 25 - 34

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A – Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results to not account for Future Wear, Maintenance or Contamination of this surface once in-situ.

Page 1 of 1 - END OF REPORT